

We had completed extensive energy efficiency improvements to the library and needed to replace an old, inefficient, oil-powered HVAC system. The town had appropriated funds to replace the library's boiler and cooling tower and to design and install a new heat pump system.


The engineers provided options for the replacement system, including installing a newer version of the oil-fired system and changing to a geothermal system. The rate of return (ROI) analysis performed by the engineering firm indicated that a geothermal HVAC system design for the library would have the most favorable ROI (12 years) and be the least invasive to the building.

The project was funded through the combined financial support of the Governor and Executive Council's award of a NH Public Utilities Commission Renewable Energy Fund grant and an Energy Efficiency Services Rebate from Eversource Energy, in combination with Town funds. This funding combination made it possible to install a state of the art closed loop geothermal thermal system at the Library.

A touch screen monitor highlighting the project is on view for the public to learn about our geothermal system.



Project cost:	\$880,000
NH Public Utilities Commission Renewable Energy Fund grant:	\$387,842
Eversource Energy Efficiency Services rebate:	\$50,000

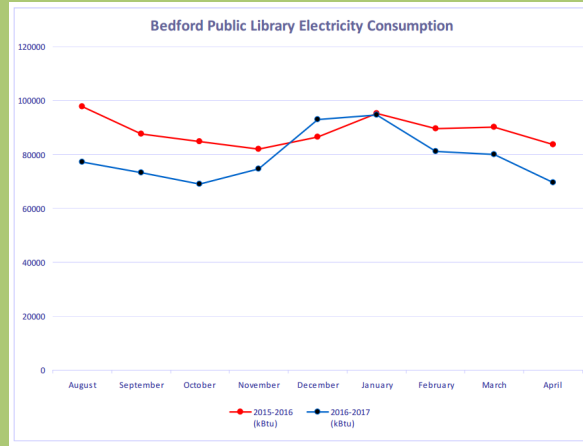

**Timeline:**

- ⇒ 2013: Facilities Study identified HVAC in need of replacement
- ⇒ July 2014: Engineering Study completed
- ⇒ September 2014: REF Grant submitted
- ⇒ June 2015: Executive Council approved grant
- ⇒ September 2015: Test pits dug
- ⇒ October 2015: RFQ issued
- ⇒ December 2015: Town Council approved additional funds & awarded contract
- ⇒ February 2016: Surveying and tree cutting completed
- ⇒ March 2016: Well drilling began
- ⇒ April 2016: Ductwork cleaned
- ⇒ May 2016: Borings covered and trench connecting to building completed
- ⇒ May 2016: Lower level units replaced
- ⇒ June 2016: Upper level units replaced
- ⇒ July 2016: Lower level units operational
- ⇒ August 2016: Upper level units operational

# Geothermal Heating & Cooling



This Library uses geothermal heat pumps to cool and heat the building.



**Bedford Public Library**  
 3 Meetinghouse Road  
 Bedford, NH 03110  
 Phone: (603) 472-2300  
[www.bedfordnhlibrary.org](http://www.bedfordnhlibrary.org)

**What is geothermal heating and cooling?**

- The geothermal system uses the stored energy of the earth for heating and cooling inside the building.
- Below 4 to 6 feet, the earth maintains a relative constant temperature year round, this is used to heat the water in the winter, and cool it during the summer.
- A typical geothermal system will consist of indoor heat pumps, a system of buried pipes and vertical bore holes.

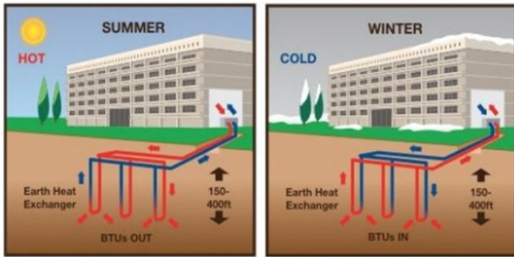


Fig.1: Overview of geothermal system operation in summer and winter.

**What are the benefits of a geothermal system?**

- The system has less mechanical components compared to a conventional system, which typically means less maintenance.
- It lowers peak electrical load on the electric system, freeing up power on the grid to be used for other purposes.
- The system does not use combustion for heating, thus it doesn't create any greenhouse gases in its operation.
- Compared to a hot water boiler, geothermal systems are much more efficient. The best boilers can get 95% efficiency. This means for 1 unit of energy that is input into the boiler, we can convert it to 0.95 units of energy for heating. With geothermal, we can get 400% efficiency, meaning for 1 unit of energy we input (the electricity needed to run the system) we can transfer 4 units of energy for heating.

**History of Geothermal Heating and Cooling**

- In 1904 the Italian scientist Piero Ginori Conti invented the first geothermal electric power plant, which used steam to generate power.
- In 1946 the first geothermal heat pump was installed at the Commonwealth Building in Portland, Oregon.
- In 1960 Pacific Gas & Electric opened the first large scale geothermal power plant (11 MW) near San Francisco, California.
- After the 1973 oil crisis, renewable energy sources gained a new importance and by the 1980's geothermal heat pumps had increased in popularity.
- In 2012 US geothermal energy produced 17 million MWh of electricity, almost enough to power the state of New Hampshire.

**Previous HVAC system at the Bedford Public Library**

- Water sourced heat pumps (WSHP) located throughout building.
- Heating provided by oil fired hot water boiler.
- Cooling provided by water cooling tower.

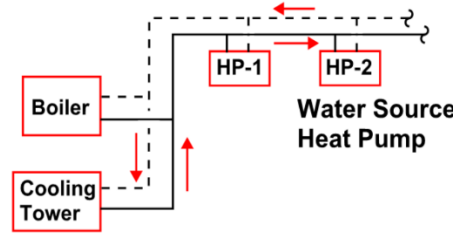


Fig.2: Simple diagram of previous HVAC system.

**New HVAC system at the Bedford Public Library**

- The existing cooling tower, boiler and heat pumps have been removed.
- 20 bore holes were drilled to a depth of 500 feet beneath the existing field adjacent to the parking lot.
- New geothermal water source heat pumps were installed.
- Emergency back-up heat will be provided by an oil fired hot water boiler should the geothermal system encounter a problem.

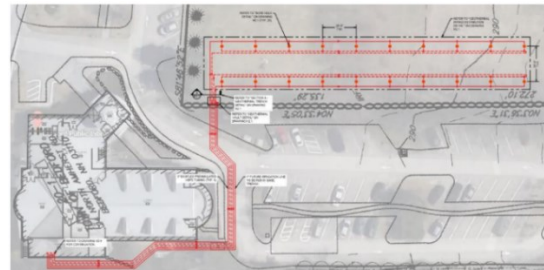


Fig.3: Layout of water piping going to wells.

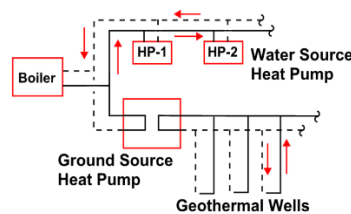


Fig.4: Simple diagram of the new HVAC system. The ground source heat pump (GSHP) separates the water loop of the water source heat pumps and the geothermal wells. In the GSHP, heat is transferred between the two loops.

**How does a water source heat pump work?**

- All heat pumps use the basic refrigeration cycle, which consists of 4 major components: the compressor, condenser, expansion valve and evaporator.
- In this cycle, a special liquid, called the refrigerant, changes phases from liquid to gas and vice versa.
- When the refrigerant changes from liquid to gas, it takes in heat, meaning it provides cooling. This occurs in the evaporator.
- When the refrigerant changes from gas to liquid, it gives out heat, meaning it provides heating. This occurs in the condenser.
- The main idea behind the heat pump is that it can switch between being an evaporator and being a condenser.
- For the heat pump to work properly it has to release heat energy in the summer and absorb heat energy in the winter. This is where the water comes into play.
- The water in a water source heat pump will absorb or release the heat energy, depending on the mode of operation.

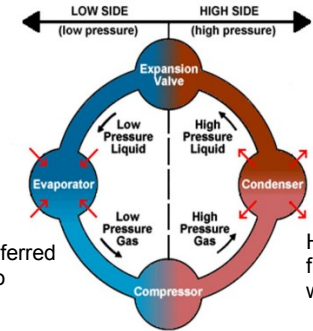


Fig.5: Simple diagram of the refrigeration cycle. This is what would be inside HP-1,2 as seen on Fig. 4 and 2. When in cooling mode, water would be receiving heat from the condenser, and when in heating mode, water would be releasing heat from the evaporator.

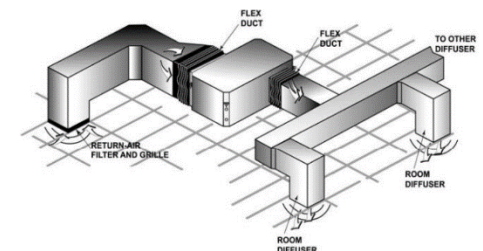


Fig.6: How an installed water source heat pump with supply & return ductwork may look.